

Proof of effect of interference from interferometer box 1-2m away from array computer/receiver box causing interference that changes the trace on array computer ezCol collection screen:


13/2/24:

Placement of interferometer computer box (white here) and Pharmigan array computer box (black box covered in green sheet under blue table near conifers at back):




LRO Test of effect Interference from Interferometer Computer Box on Pharmigan Array Computer.

Dehumidifier turned ON in array box, whole of interferometer box switched OFF:

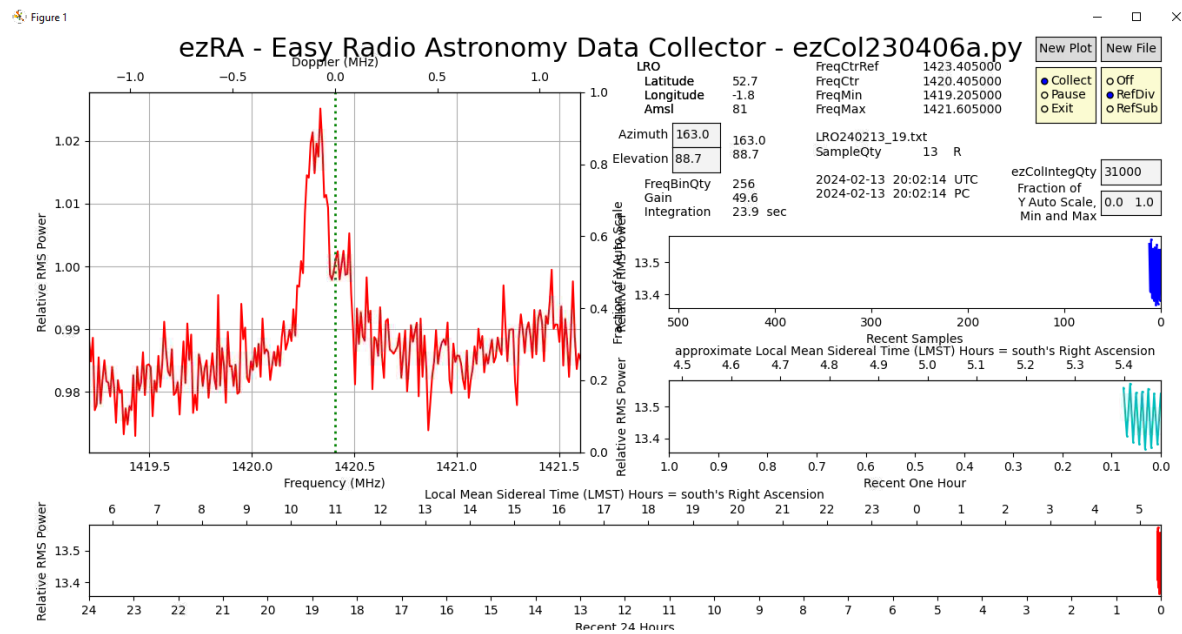


Dehumidifier turned OFF in array box, whole of interferometer box switched OFF:

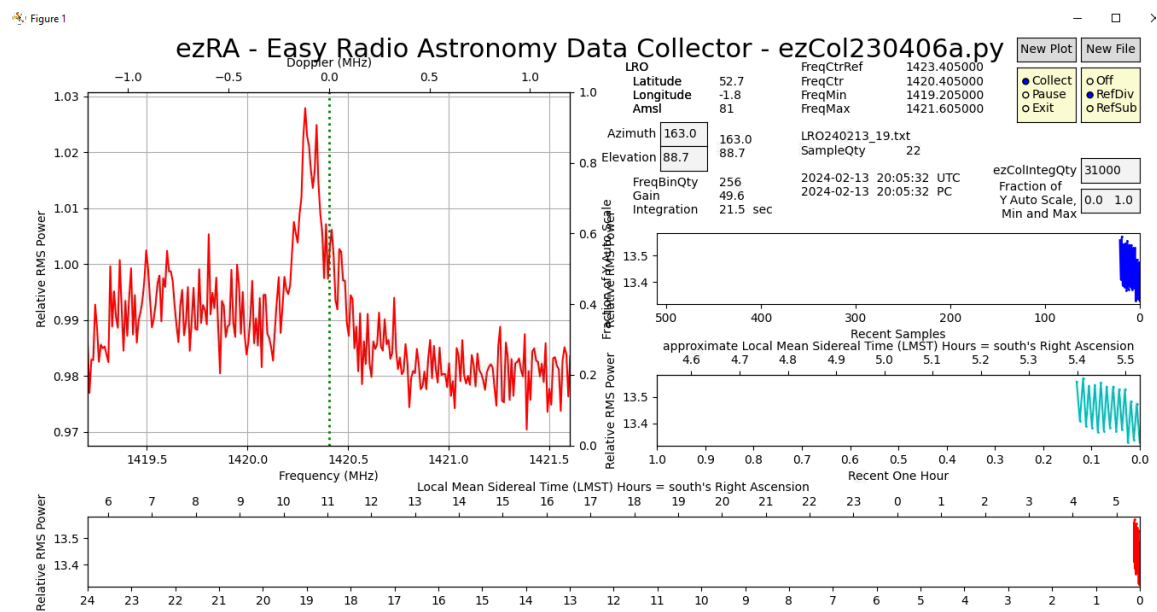


LRO Test of effect Interference from Interferometer Computer Box on Pharmigan Array Computer.

Dehumidifier turned ON in array box, whole of interferometer box switched OFF:

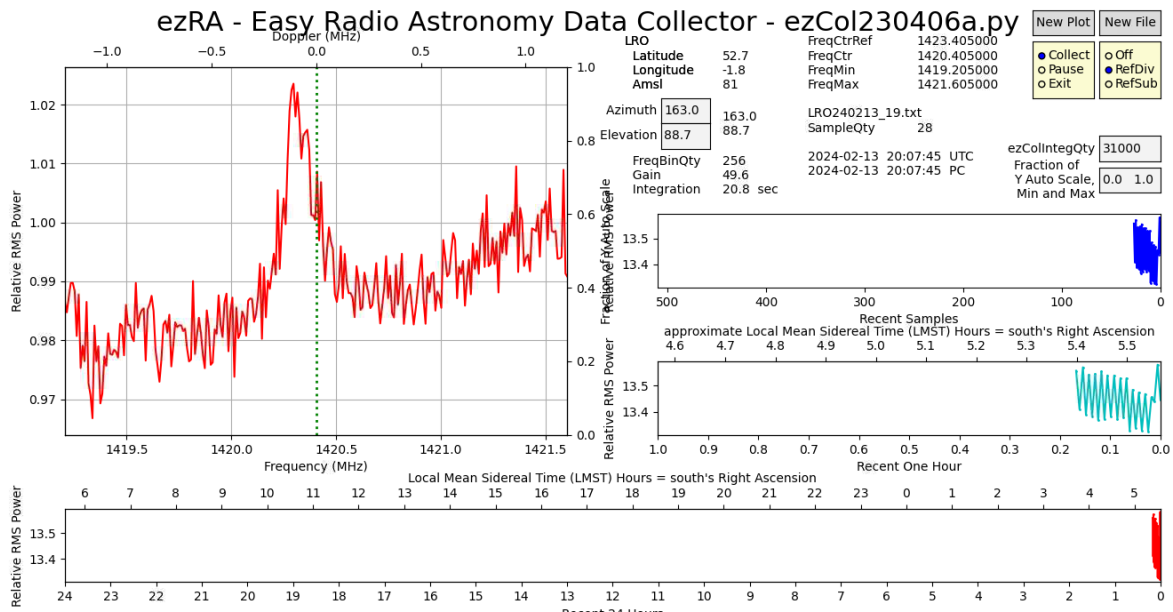

Dehumidifier turned ON in array box, whole of interferometer box switched ON:

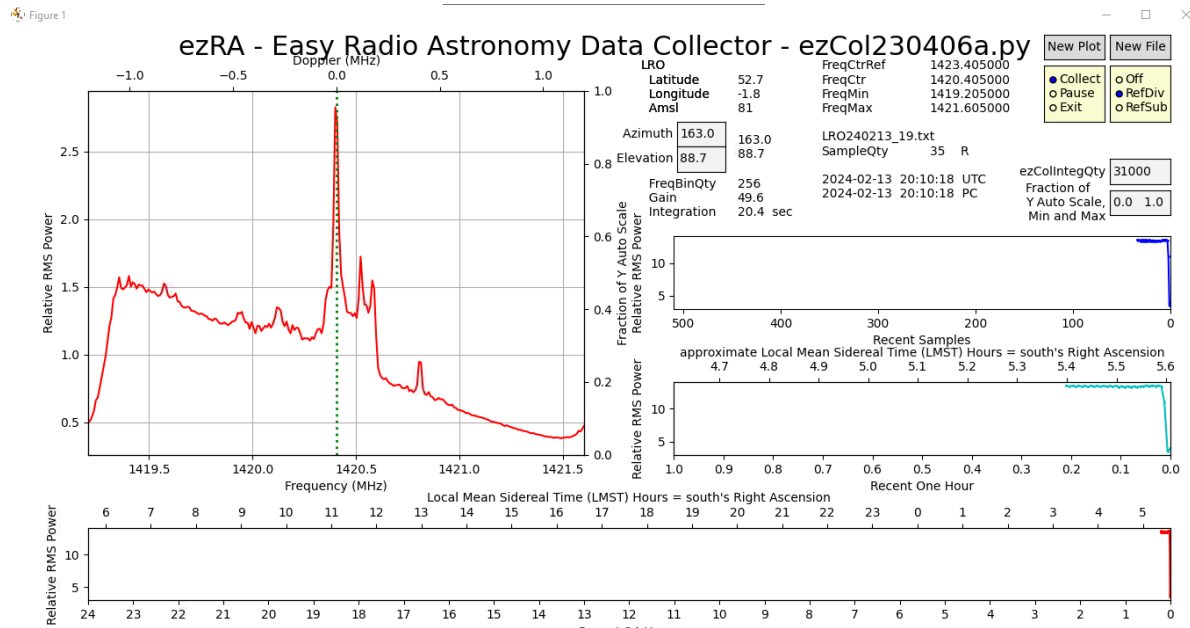

LRO Test of effect Interference from Interferometer Computer Box on Pharmigan Array Computer.

Figure 1

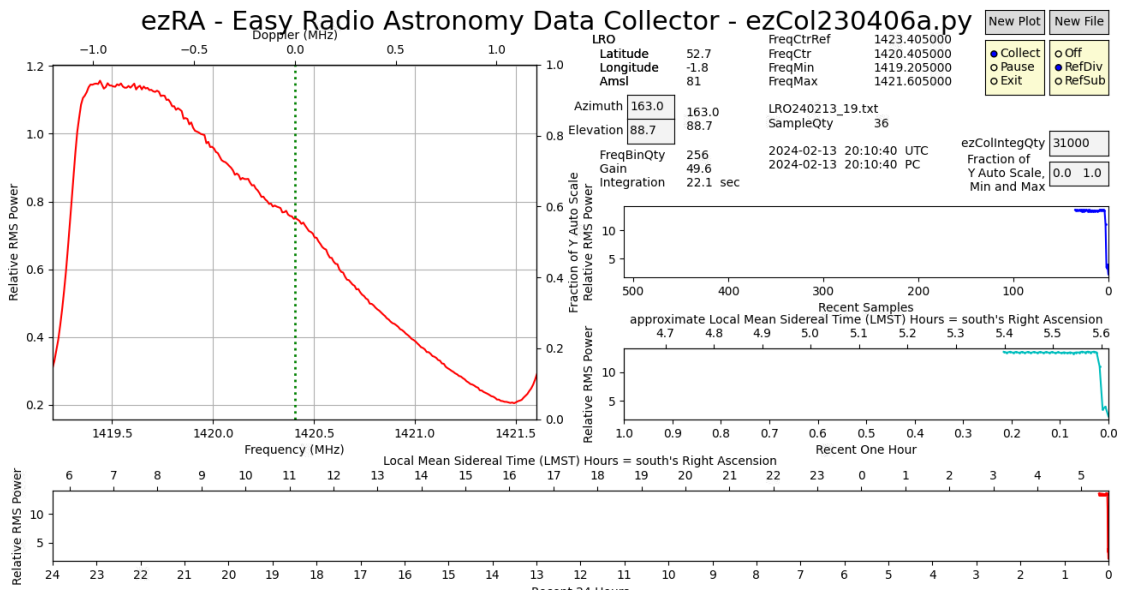


Figure 1


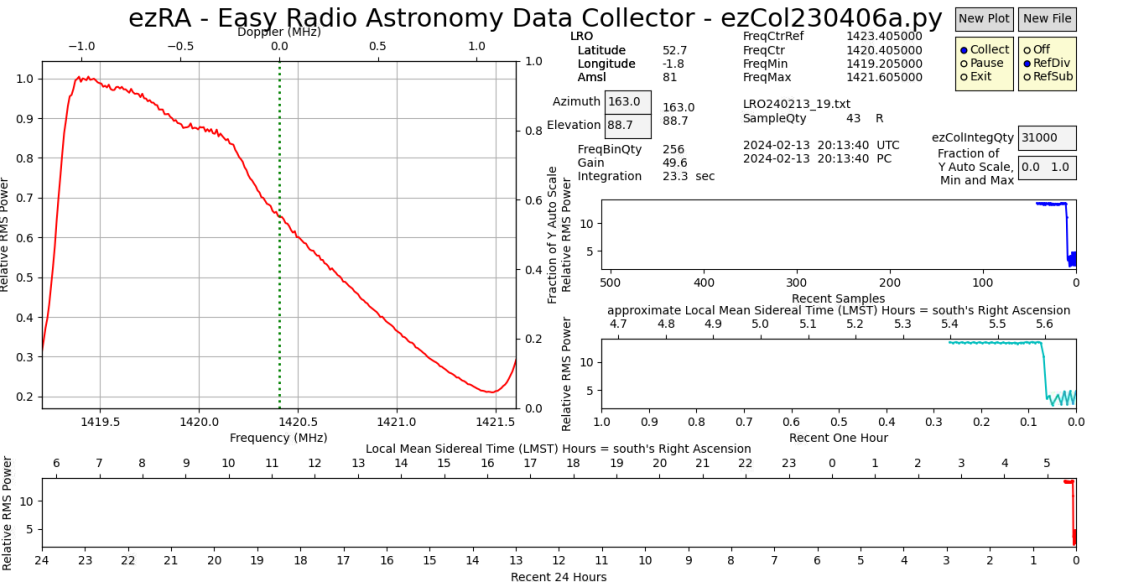


Figure 1



Dehumidifier turned ON in array box, whole of interferometer box switched OFF again:

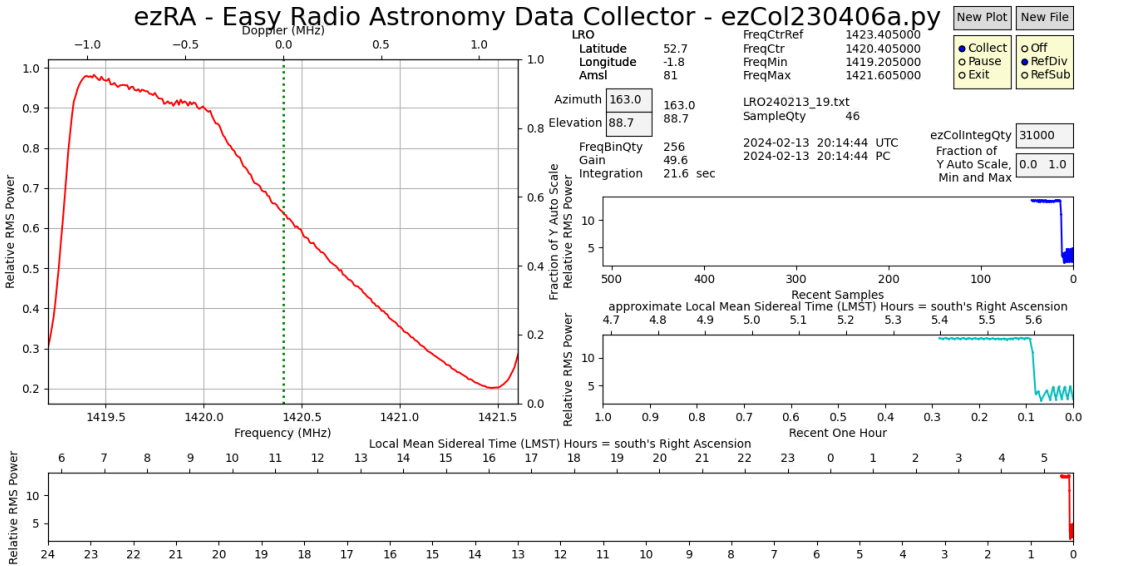